SIEMENS

Data sheet

3RT2018-1AP02



power contactor, AC-3e/AC-3, 16 A, 7.5 kW / 400 V, 3-pole, 230 V AC, 50/60 Hz, auxiliary contacts: 1 NC, screw terminal, size: S00

product brand name	SIRIUS
product designation	Power contactor
product type designation	3RT2
General technical data	
size of contactor	S00
product extension	
 function module for communication 	No
auxiliary switch	Yes
power loss [W] for rated value of the current	
 at AC in hot operating state 	3 W
 at AC in hot operating state per pole 	1 W
 without load current share typical 	1.5 W
type of calculation of power loss depending on pole	quadratic
insulation voltage	
 of main circuit with degree of pollution 3 rated value 	690 V
 of auxiliary circuit with degree of pollution 3 rated value 	690 V
surge voltage resistance	
 of main circuit rated value 	6 kV
 of auxiliary circuit rated value 	6 kV
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 ∨
shock resistance at rectangular impulse	
• at AC	7,3g / 5 ms, 4,7g / 10 ms
shock resistance with sine pulse	
• at AC	11,4g / 5 ms, 7,3g / 10 ms
mechanical service life (operating cycles)	
 of contactor typical 	30 000 000
 of the contactor with added electronically optimized auxiliary switch block typical 	5 000 000
 of the contactor with added auxiliary switch block typical 	10 000 000
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2009
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
 during operation 	-25 +60 °C
 during storage 	-55 +80 °C
relative humidity minimum	10 %
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %
Environmental footprint	

	Vec
Environmental Product Declaration(EPD)	Yes
Global Warming Potential [CO2 eq] total	39.6 kg
Global Warming Potential [CO2 eq] during manufacturing	1.18 kg
Global Warming Potential [CO2 eq] during operation	38.5 kg
Global Warming Potential [CO2 eq] after end of life	-0.155 kg
Main circuit	2
number of poles for main current circuit number of NO contacts for main contacts	3 3
operating voltage	5
at AC-3 rated value maximum	690 V
at AC-3e rated value maximum	690 V
operational current	
 at AC-1 at 400 V at ambient temperature 40 °C rated value 	22 A
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated value	22 A
— up to 690 V at ambient temperature 60 °C rated value	20 A
• at AC-3	
- at 400 V rated value	16 A
- at 500 V rated value	12.4 A
— at 690 V rated value • at AC-3e	8.9 A
• at AC-3e — at 400 V rated value	16 A
— at 500 V rated value	12.4 A
— at 690 V rated value	8.9 A
at AC-4 at 400 V rated value	11.5 A
• at AC-5a up to 690 V rated value	19.4 A
• at AC-5b up to 400 V rated value	13.2 A
• at AC-6a	
 — up to 230 V for current peak value n=20 rated value 	9.6 A
— up to 400 V for current peak value n=20 rated value	9.6 A
 — up to 500 V for current peak value n=20 rated value 	9.6 A
— up to 690 V for current peak value n=20 rated value	8.9 A
● at AC-6a	
 — up to 230 V for current peak value n=30 rated value 	6.6 A
 — up to 400 V for current peak value n=30 rated value 	6.4 A
 — up to 500 V for current peak value n=30 rated value 	6.4 A
— up to 690 V for current peak value n=30 rated value	6.4 A
minimum cross-section in main circuit at maximum AC-1 rated value	4 mm ²
operational current for approx. 200000 operating cycles at AC-4	
• at 400 V rated value	5.5 A
• at 690 V rated value	4.4 A
operational current	
at 1 current path at DC-1	
— at 24 V rated value	20 A
- at 60 V rated value	20 A
— at 110 V rated value	2.1 A
- at 220 V rated value	0.8 A
— at 440 V rated value — at 600 V rated value	0.6 A 0.6 A
with 2 current paths in series at DC-1	0.0 A
- at 24 V rated value	20 A
— at 60 V rated value	20 A
— at 110 V rated value	12 A
— at 220 V rated value	1.6 A
— at 440 V rated value	0.8 A
— at 600 V rated value	0.7 A
• with 3 current paths in series at DC-1	

— at 24 V rated value	20 A
— at 60 V rated value	20 A
— at 110 V rated value	20 A
— at 220 V rated value	20 A
— at 440 V rated value	1.3 A
— at 600 V rated value	1 A
 at 1 current path at DC-3 at DC-5 	
— at 24 V rated value	20 A
— at 60 V rated value	0.5 A
— at 110 V rated value	0.15 A
 with 2 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	20 A
— at 60 V rated value	5 A
— at 110 V rated value	0.35 A
 with 3 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	20 A
— at 60 V rated value	20 A
— at 110 V rated value	20 A
— at 220 V rated value	1.5 A
— at 440 V rated value	0.2 A
— at 600 V rated value	0.2 A
operating power	
• at AC-3	
— at 230 V rated value	4 kW
— at 400 V rated value	7.5 kW
— at 500 V rated value	7.5 kW
— at 690 V rated value	7.5 kW
• at AC-3e	
— at 230 V rated value	4 kW
— at 400 V rated value	7.5 kW
— at 500 V rated value	7.5 kW
— at 690 V rated value	7.5 kW
operating power for approx. 200000 operating cycles at AC- 4	
 at 400 V rated value 	2.5 kW
at 690 V rated value	3.5 kW
operating apparent power at AC-6a	0.0 KW
up to 230 V for current peak value n=20 rated value	3.8 kVA
• up to 400 V for current peak value n=20 rated value	6.6 kVA
• up to 500 V for current peak value n=20 rated value	8.3 kVA
• up to 690 V for current peak value n=20 rated value	10.6 kVA
operating apparent power at AC-6a	10.0 КУЛ
up to 230 V for current peak value n=30 rated value	2.5 kVA
 up to 250 v for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	4.4 kVA
 up to 500 V for current peak value n=30 rated value 	5.5 kVA
• up to 690 V for current peak value n=30 rated value	7.6 kVA
short-time withstand current in cold operating state up to	
40 °C	
 limited to 1 s switching at zero current maximum 	300 A; Use minimum cross-section acc. to AC-1 rated value
 limited to 5 s switching at zero current maximum 	169 A; Use minimum cross-section acc. to AC-1 rated value
 limited to 10 s switching at zero current maximum 	128 A; Use minimum cross-section acc. to AC-1 rated value
 limited to 30 s switching at zero current maximum 	92 A; Use minimum cross-section acc. to AC-1 rated value
 limited to 60 s switching at zero current maximum 	74 A; Use minimum cross-section acc. to AC-1 rated value
no-load switching frequency	
• at AC	10 000 1/h
operating frequency	
• at AC-1 maximum	1 000 1/h
• at AC-2 maximum	750 1/h
• at AC-3 maximum	750 1/h
• at AC-3e maximum	750 1/h
• at AC-4 maximum	250 1/h

type of voltage of the control supply voltageACcontrol supply voltage at AC230 V• at 50 Hz rated value230 V• at 60 Hz rated value230 Voperating range factor control supply voltage rated value of magnet coil at AC0.8 1.1• at 50 Hz0.8 1.1• at 60 Hz0.85 1.1apparent pick-up power of magnet coil at AC37 VA• at 60 Hz33 VAinductive power factor with closing power of the coil0.8• at 50 Hz0.75apparent holding power of magnet coil at AC• at 60 Hz0.75apparent holding power of magnet coil at AC• at 60 Hz0.75apparent holding power of magnet coil at AC• at 60 Hz0.75	
control supply voltage at AC 230 V • at 50 Hz rated value 230 V • at 60 Hz rated value 230 V operating range factor control supply voltage rated value of magnet coil at AC 0.8 1.1 • at 50 Hz 0.8 1.1 • at 60 Hz 0.85 1.1 apparent pick-up power of magnet coil at AC 37 VA • at 50 Hz 33 VA inductive power factor with closing power of the coil 0.8 • at 50 Hz 0.8 • at 50 Hz 0.8 • at 60 Hz 0.8 • at 50 Hz 0.8 • at 60 Hz 0.75 • at 60 Hz 0.75	
• at 50 Hz rated value230 V• at 60 Hz rated value230 Voperating range factor control supply voltage rated value of magnet coil at AC230 V• at 50 Hz0.8 1.1• at 60 Hz0.85 1.1apparent pick-up power of magnet coil at AC37 VA• at 50 Hz33 VA• at 60 Hz33 VA• at 60 Hz0.8• at 60 Hz0.8• at 60 Hz0.8• at 60 Hz37 VA• at 60 Hz0.8• at 60 Hz0.75	
operating range factor control supply voltage rated value of magnet coil at AC0.8 1.1• at 50 Hz0.8 1.1• at 60 Hz0.85 1.1apparent pick-up power of magnet coil at AC	
magnet coil at AC0.8 1.1• at 50 Hz0.85 1.1• at 60 Hz0.85 1.1apparent pick-up power of magnet coil at AC37 VA• at 50 Hz33 VA• at 60 Hz33 VAinductive power factor with closing power of the coil0.8• at 50 Hz0.8• at 60 Hz0.8• at 60 Hz0.8• at 60 Hz0.75	
• at 50 Hz0.8 1.1• at 60 Hz0.85 1.1apparent pick-up power of magnet coil at AC0.85 1.1• at 50 Hz37 VA• at 60 Hz33 VAinductive power factor with closing power of the coil0.8• at 50 Hz0.8• at 60 Hz0.75apparent holding power of magnet coil at AC0.75	
• at 60 Hz0.85 1.1apparent pick-up power of magnet coil at AC37 VA• at 50 Hz37 VA• at 60 Hz33 VAinductive power factor with closing power of the coil0.8• at 50 Hz0.8• at 60 Hz0.75apparent holding power of magnet coil at AC0.75	
apparent pick-up power of magnet coil at AC37 VA• at 50 Hz37 VA• at 60 Hz33 VAinductive power factor with closing power of the coil0.8• at 50 Hz0.75apparent holding power of magnet coil at AC0.75	
• at 50 Hz 37 VA • at 60 Hz 33 VA inductive power factor with closing power of the coil 0.8 • at 50 Hz 0.75 apparent holding power of magnet coil at AC 0.75	
• at 60 Hz 33 VA inductive power factor with closing power of the coil 0.8 • at 50 Hz 0.8 • at 60 Hz 0.75	
inductive power factor with closing power of the coil 0.8 • at 50 Hz 0.75 apparent holding power of magnet coil at AC 0.75	
at 50 Hz 0.8 o at 60 Hz 0.75 apparent holding power of magnet coil at AC	
• at 60 Hz 0.75 apparent holding power of magnet coil at AC	
apparent holding power of magnet coil at AC	
• at 60 Hz 4.4 VA	
inductive power factor with the holding power of the coil	
• at 50 Hz 0.25	
• at 60 Hz 0.25	
closing delay	
• at AC 9 35 ms	
opening delay	
• at AC 4 15 ms	
arcing time 10 15 ms	
control version of the switch operating mechanism Standard A1 - A2	
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous 1	
contact	
operational current at AC-12 maximum 10 A	
operational current at AC-15	
at 230 V rated value 10 A 10 A 3 A	
at 400 V rated value 3 A at 500 V rated value 2 A	
• at 500 V rated value • at 690 V rated value 1 A	
operational current at DC-12	
• at 24 V rated value 10 A	
• at 48 V rated value 6 A	
• at 60 V rated value 6 A	
• at 100 V rated value 3 A	
• at 125 V rated value 2 A	
• at 220 V rated value 1 A	
• at 600 V rated value 0.15 A	
operational current at DC-13	
• at 24 V rated value 10 A	
• at 48 V rated value 2 A	
• at 60 V rated value 2 A	
• at 110 V rated value 1 A	
• at 125 V rated value 0.9 A	
• at 220 V rated value 0.3 A	
• at 600 V rated value 0.1 A	
contact reliability of auxiliary contacts 1 faulty switching per 100 million (17 V, 1 mA)	
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
• at 480 V rated value 14 A	
• at 600 V rated value 11 A	
yielded mechanical performance [hp]	
for single-phase AC motor	
- at 110/120 V rated value 1 hp	
— at 230 V rated value 2 hp	

e for 3 phase AC motor	
 for 3-phase AC motor — at 200/208 V rated value 	3 hp
— at 200/208 V rated value	5 hp
— at 460/480 V rated value	5 np 10 hp
— at 575/600 V rated value	10 hp
contact rating of auxiliary contacts according to UL	A600 / Q600
Short-circuit protection	
design of the fuse link	
for short-circuit protection of the main circuit	
- with type of coordination 1 required	gG: 50A (690V,100kA), aM: 25A (690V,100kA), BS88: 50A (415V,80kA)
— with type of assignment 2 required	gG: 25A (690V,100kA), aM: 20A (690V,100kA), BS88: 25A (415V,80kA)
 for short-circuit protection of the auxiliary switch required 	gG: 10 A (500 V, 1 kA)
Installation/ mounting/ dimensions	
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and
	backward by +/- 22.5° on vertical mounting surface
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715
height	58 mm
width	45 mm
depth	73 mm
required spacing	
 with side-by-side mounting 	
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	0 mm
for grounded parts	
— forwards	10 mm
— upwards	10 mm
— at the side	6 mm
— downwards	10 mm
for live parts forwards	10 mm
— forwards	10 mm
— upwards — downwards	10 mm 10 mm
— downwards — at the side	6 mm
Connections/ Terminals	
type of electrical connection	
for main current circuit	screw-type terminals
 for auxiliary and control circuit 	screw-type terminals
at contactor for auxiliary contacts	Screw-type terminals
of magnet coil	Screw-type terminals
type of connectable conductor cross-sections	
for main contacts	
— solid	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²), 2x 4 mm²
— solid or stranded	2x (0,5 1,5 mm ²), 2x (0,75 2,5 mm ²), 2x 4 mm ²
— finely stranded with core end processing	2x (0.5 1.5 mm ²), 2x (0.75 2.5 mm ²)
for AWG cables for main contacts	2x (20 16), 2x (18 14), 2x 12
connectable conductor cross-section for main contacts	
• solid	0.5 4 mm²
stranded	0.5 4 mm²
 finely stranded with core end processing 	0.5 2.5 mm²
connectable conductor cross-section for auxiliary contacts	
solid or stranded	0.5 4 mm²
 finely stranded with core end processing 	0.5 2.5 mm²
type of connectable conductor cross-sections	
 for auxiliary contacts 	
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²), 2x 4 mm²
 finely stranded with core end processing 	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
 for AWG cables for auxiliary contacts 	2x (20 16), 2x (18 14), 2x 12
AWG number as coded connectable conductor cross section	

 for main contacts 	S		20 12			
 for auxiliary cont 	acts		20 12			
Safety related data						
product function						
•	ccording to IEC 60947-4-	1	Yes			
	y-related switching OFF		Yes; applies only to contactor operating mechanism			
proportion of danger						
• with low demand rate according to SN 31920			40 %			
with high demand rate according to SN 31920		73 %				
B10 value with high demand rate according to SN 31920		1 000 000				
failure rate [FIT] with low demand rate according to SN 31920 31920		100 FIT				
IEC 61508						
T1 value						
 • for proof test interval or service life according to IEC 61508 		ding to IEC	20 a			
Electrical Safety						
	the front according to	IEC 60529	IP20			
	he front according to IE		finger-safe, for vertical contact	from the front		
Approvals Certificates	-					
General Product App	roval					
(SP)	CE	UK	<u>Confirmation</u>	(m)	መ	
CSA	EG-Konf.			ccc	UL	
General Product App	roval	EMV	Functional Saftey	Test Certificates		
	roval	EMV				
General Product App KC	roval	EMV	Type Examination Cer-	Type Test Certific-	<u>Special Test Certific-</u> ate	
	roval	EMV			Special Test Certific- ate	
	FRE		Type Examination Cer-	Type Test Certific-		
	FRE		Type Examination Cer-	Type Test Certific-		
KC	roval		Type Examination Cer-	Type Test Certific-		
	FRE	EMV RCM	Type Examination Cer-	Type Test Certific-		
KC	roval		Type Examination Cer-	Type Test Certific-		
KC	FREE	EMV RCM	Type Examination Cer-	Type Test Certific-		
KC	Froval	RCM	Type Examination Cer- tificate	Type Test Certific-		
KC	EAU	EMV RCM	Type Examination Cer-	Type Test Certific-		
KC	Proval EEEE UREAU VERITAS	RCM	Type Examination Cer- tificate	Type Test Certific-		
KC	EAU	RCM	Type Examination Cer- tificate	Type Test Certific-		
KC Marine / Shipping	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report		
KC Marine / Shipping	EHC BUREAU VERITAS	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report		
KC Marine / Shipping	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Environment	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Environment Environmental Con-	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Environment	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Colspa="2" Colspa="2" Colspa="2" Colspan="2" Colspa="">"Colspan="2" Col		
KC Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Environment Environmental Con-	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Certific- ates/Test Report Image: colspan="2">Image: colspan="2" Certific- press Image: colspan="2" Certific- Special Test Certific-		
KC Marine / Shipping Marine / Shipping Marine / Shipping Marine / Shipping Environment Environmental Con-	EFFC	RCM	Type Examination Cer- tificate	Type Test Certific- ates/Test Report Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2">Image: colspan="2" Certific- ates/Test Report Image: colspan="2">Image: colspan="2" Certific- press Image: colspan="2" Certific- Special Test Certific-		

 Further information

 Information on the packaging

 https://support.industry.siemens.com/cs/ww/en/view/109813875

 Information- and Downloadcenter (Catalogs, Brochures,...)

 https://www.siemens.com/ic10

 Industry Mall (Online ordering system)

 https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT2018-1AP02

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RT2018-1AP02 Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


https://support.industry.siemens.com/cs/ww/en/ps/3RT2018-1AP02


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT2018-1AP02&lang=en


Characteristic: Tripping characteristics, I²t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RT2018-1AP02/char


Further characteristics (e.g. electrical endurance, switching frequency)


earch&mlfb=3RT2018-1AP02&objecttype=14&gridview=view1 http://www.automation.siemens.com/bilddb/index.aspx?view=S







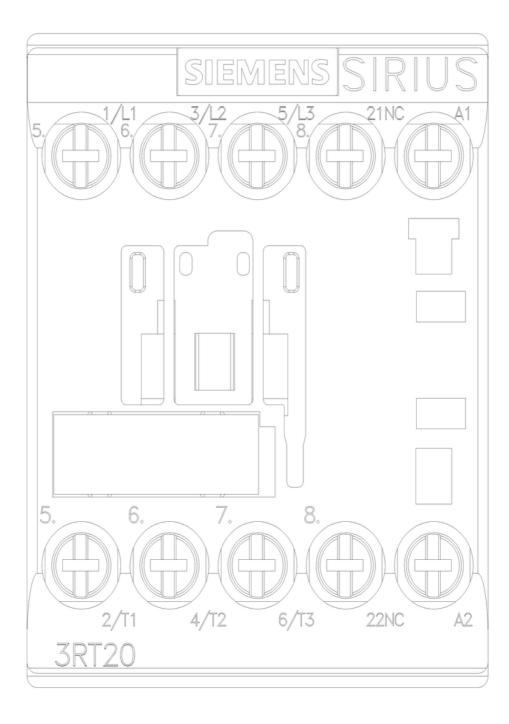

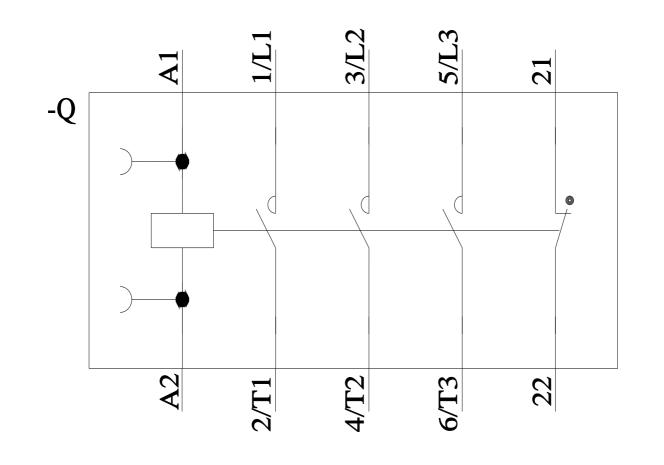

last modified:

3/15/2024 🖸