



SENTRON, measuring device, 7KM PAC4200, LCD, L-L: 500 V, L-N: 289 V, 5 A, 3-phase, Modbus TCP, optional Modbus RTU / PROFINET / PROFIBUS / DI/DO, apparent/active/reactive energy / cos phi, harmonics: 2.-64., THD, class 0.2 acc. to IEC61557-12 or cl. 0.2S acc. to IEC62053-22, ext-low volt. pwr sup. unit DC, screw terminals

Model	
product brand name	SENTRON
product designation	Measuring device for power system quality measurement
design of the product	compact
product type designation	7KM PAC4200
Measurements	
measuring procedure	
• for voltage measurement	TRMS
• for current measurement	TRMS
type of measured value detection	complete
voltage curve	Sinusoidal or distorted
measurable line frequency	
• initial value	45 Hz
• full-scale value	65 Hz
operating mode for measured value detection automatic line frequency detection	Yes
operating mode for measured value detection	
• set at 50 Hz	No
• set to 60 Hz	No
Supply voltage	
design of the power supply	Extra-low voltage power supply unit
type of voltage of the supply voltage	DC
supply voltage at DC	22 ... 65 V
Degree of protection protection class	
protection class IP on the front	IP65
operating resource protection class when installed	II
Suitability	
suitability for operation	Installation in stationary panels in closed rooms
Product Functions	
product function	
• voltage measurement	Yes
• current measurement	Yes
• active power measurement	Yes
• reactive power measurement	Yes
• frequency measurement	Yes
Display and operation	
design of the display	LCD
height of the display	54 mm
width of the display	72 mm
color of the background of the display	white

illuminance of display backlight adjustable	Yes
time-controlled reduction of the illuminance of display backlight possible	Yes
display contrast adjustable	Yes
national language on the display screen is supported	ger, en, fr, spa, ita, por, tur, rus, chi, pol
number of keys	4
Communication	
number of interfaces according to Fast Ethernet	1
type of electrical connection of the fast Ethernet interface	RJ45 (8P8C)
protocol at the Ethernet interface is supported	MODBUS TCP
transfer rate 1 for Ethernet	10 Mbit/s
transfer rate 2 for Ethernet	100 Mbit/s
Fault limits	
reference condition for metering accuracy	according to IEC61557-12
formula for relative total measurement inaccuracy	<ul style="list-style-type: none"> • for measured variable voltage +/- 0,2 % • for measured variable current +/- 0,2 % • for measured variable output factor +/- 2 % • for measured variable active energy Class 0.2 according to IEC61557-12 and/or class 0.2S according to IEC62053-22 • for measured variable reactive energy Class 2 according to IEC61557-12 and/or IEC62053-23
Inputs Outputs	
number of digital inputs	2
type of electrical connection at the digital inputs	screw-type terminals
operating conditions for digital inputs external voltage supply	Yes
input voltage at digital input at DC maximum	30 V
number of digital outputs	2
type of switching output	solid state
digital output version	switching or pulse output function
operating voltage as output voltage at DC maximum permissible	30 V
type of electrical connection at the digital outputs	screw-type terminals
output current	<ul style="list-style-type: none"> • at digital output with signal <0> maximum 0.2 mA • at digital output for signal <1> maximum 27 mA • at the digital outputs at DC limited to 100 ms maximum 300 mA
internal resistance at the digital outputs	55 Ω
standard for pulse emitter	according to IEC62053-31
pulse duration	<ul style="list-style-type: none"> • initial value 30 ms • full-scale value 500 ms
adjustable time period minimum	10 ms
switching frequency at digital output maximum	20 Hz
property of the output short-circuit proof	Yes
measuring category for digital signals	CATI
Measuring inputs	
measurable supply voltage between (PE)N and L at AC maximum rated value	289 V
measurable supply voltage between (PE)N and L at AC	
• minimum	11.5 V
• maximum	346 V
measurable supply voltage between the line conductors at AC maximum rated value	500 V
measurable supply voltage between the line conductors at AC	
• minimum	20 V
• maximum	600 V
voltage measuring range extension with external voltage transformers	yes
line conductors and neutral conductors internal resistance for voltage measurement	1.05 MΩ
measuring category for voltage measurement	CATIII
measurable current	
• 1 at AC rated value	1 A

• 2 at AC rated value	5 A
relative measurable current at AC	
• minimum	1 %
• maximum	120 %
current measuring range extension with external current transformers	Yes
zero point suppression for current measurement	0 ... 10 %
measuring category for current measurement	CATIII

Connections

type of connectable conductor cross-sections	
• at the measurement inputs for voltage solid	1x (0.5 ... 4 mm ²), 2x (0.5 ... 2.5 mm ²)
• at the measurement inputs for voltage finely stranded with core end processing	1x (0.5 ... 2.5 mm ²), 2x (0.5 ... 1.5 mm ²)
• at the measurement inputs for voltage for AWG cables solid	2x 20 to 14
• at the measurement inputs for current solid	1x (0.5 ... 4 mm ²), 2x (0.5 ... 2.5 mm ²)
• at the measurement inputs for current finely stranded with core end processing	1x (0.5 ... 2.5 mm ²), 2x (0.5 ... 1.5 mm ²)
• at the measurement inputs for current for AWG cables solid	2x 20 to 14
type of electrical connection	
• at the measurement inputs for voltage	screw-type terminals
• at the measurement inputs for current	screw-type terminals

Mechanical Design

fastening method standard rail mounting	No
size of Power Monitoring Device	size 96
height	96 mm
width	96 mm
depth	82 mm
installation depth	77 mm
net weight	537 g
mounting position	vertical

Environmental conditions

ambient temperature during operation	
• minimum	-10 °C
• maximum	55 °C
ambient temperature during storage	
• minimum	-25 °C
• maximum	70 °C
relative humidity at 25 °C without condensation during operation maximum	95 %
installation altitude at height above sea level maximum	2 000 m
degree of pollution	2

Certificates

certificate of suitability as EC Declaration of Conformity	IEC 61010-1: 2001 (2nd Ed.) with Corr. 1, EN 61010-1: 2001 (2nd Ed.) and DIN EN 61010-1:2002 with "Berichtigung 1"
reference code according to EN 61346-2	P

General Product Approval	EMC	Declaration of Conformity
--------------------------	-----	---------------------------

[Confirmation](#)



EG-Konf.

other	Dangerous Good	Environment
-------	----------------	-------------

[Confirmation](#)

[Miscellaneous](#)

[Dangerous Goods Information](#)

[Environmental Confirmations](#)

Further information

Siemens has decided to exit the Russian market (see here).

<https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business>

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

<https://support.industry.siemens.com/cs/ww/en/view/109813875>

Information- and Downloadcenter (catalogues, leaflets,...)

<http://www.siemens.com/energy-automation>

Industry Mall (Online ordering system)

<https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=7KM4211-1BA00-3AA0>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<https://support.industry.siemens.com/cs/ww/en/ps/7KM4211-1BA00-3AA0>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)


http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=7KM4211-1BA00-3AA0


CAx-Online-Generator

<http://www.siemens.com/cax>

Tender specifications

<http://www.siemens.com/specifications>

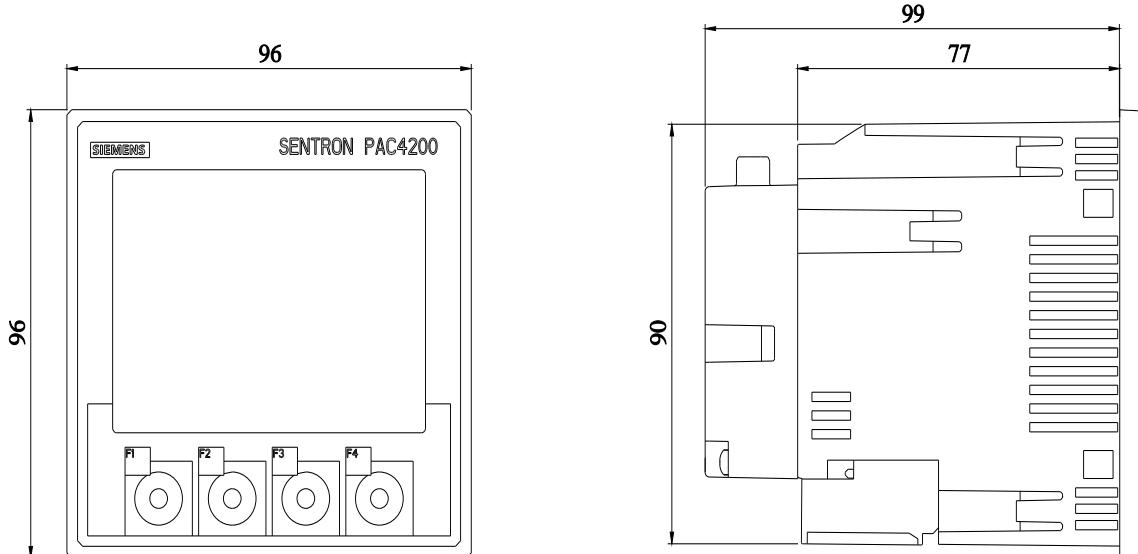

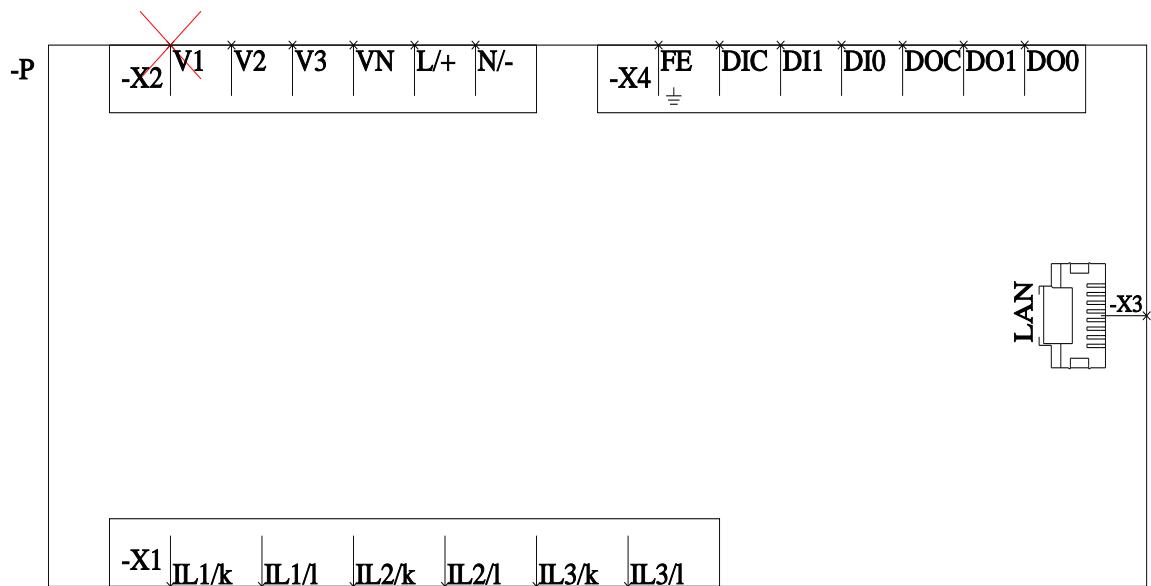

last modified:

7/4/2023

